



PA-SHT REV

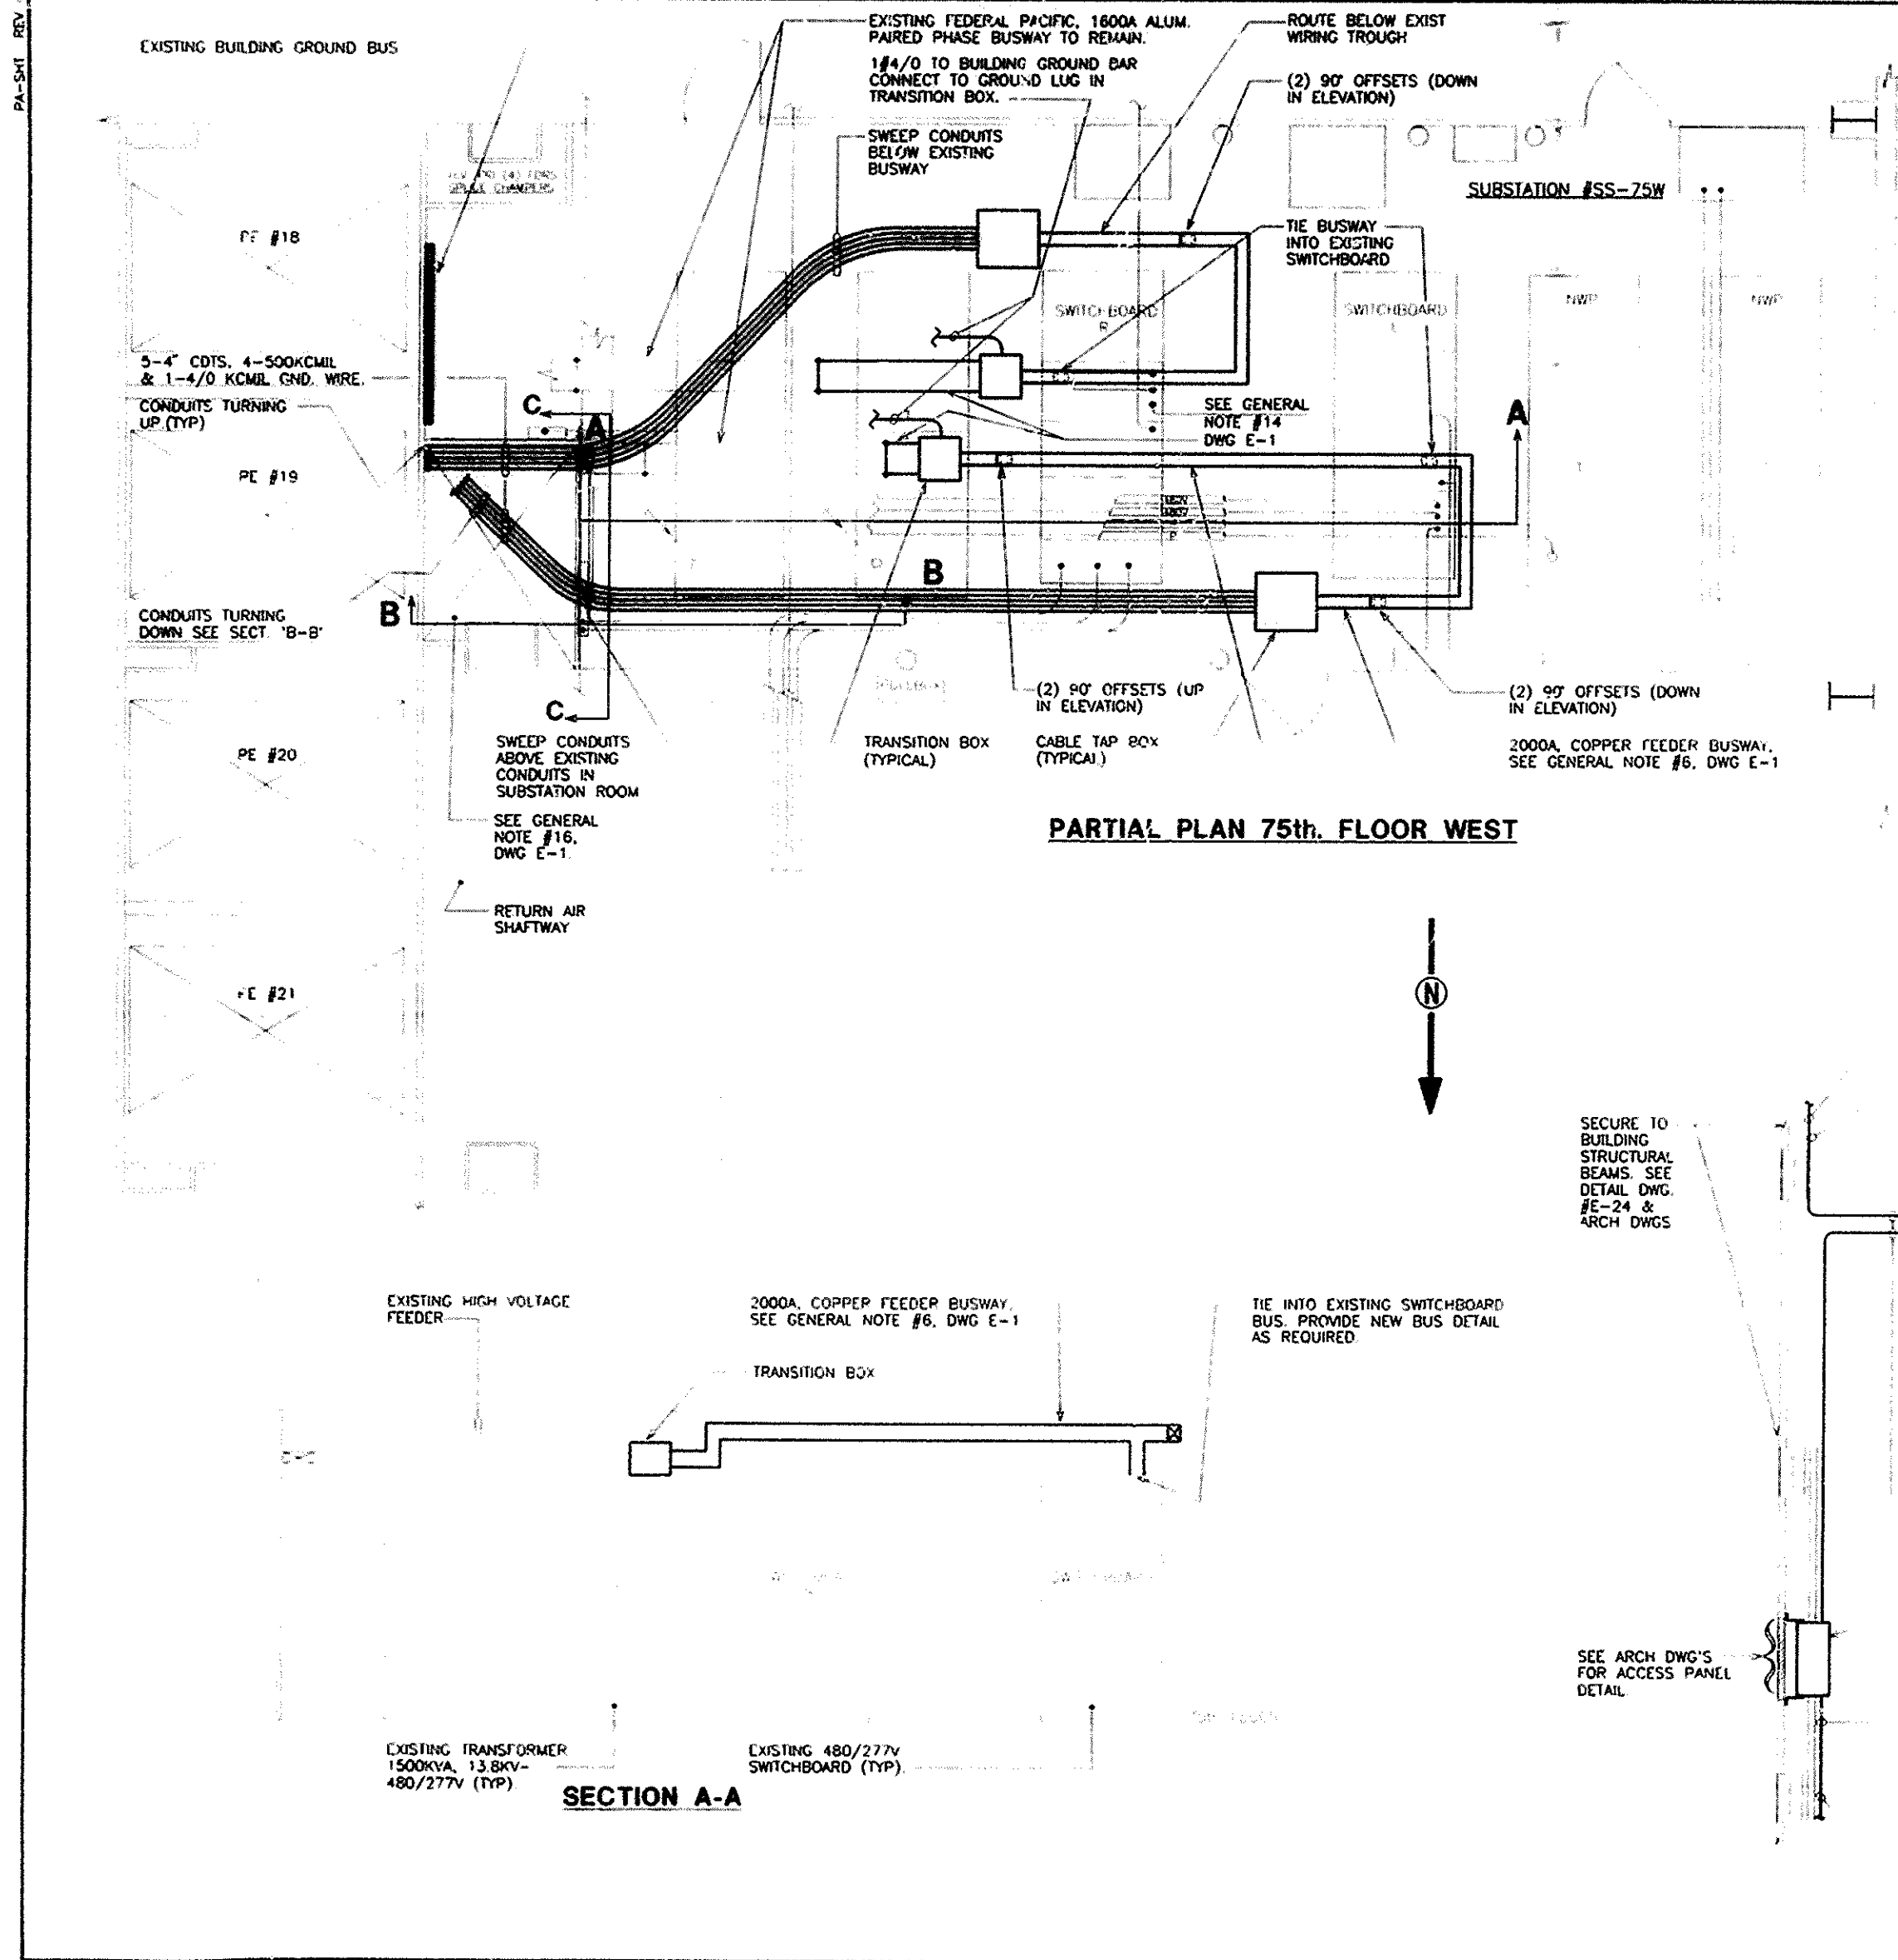


**NOTES:**

1. SEE DRAWING E-1 FOR BUSWAY SCHEDULE & GENERAL NOTES.
2. TRANSFORMERS & SWITCHBOARDS WILL BE LIVE DURING INSTALLATION.

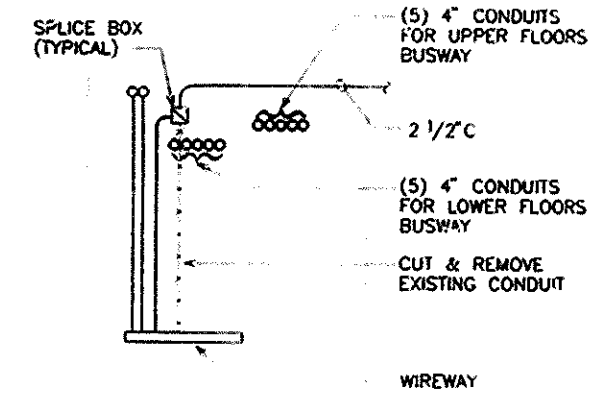

**SECTION C-C**

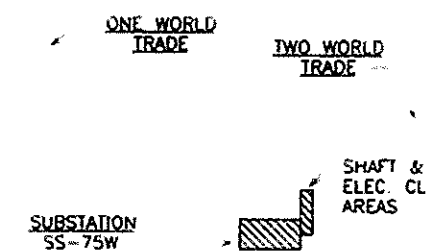


Sheet 35 of 41

**THE PORT AUTHORITY OF NY & NJ**

*James J. Lohr*  
Engineering Program Manager

**EDWARDS AND ZUCK, P.C.**  
CONSULTING ENGINEERS  
330 West 42nd Street, New York, NY 10036  
212-734-3400  
© 1992 Edwards and Zuck, P.C.

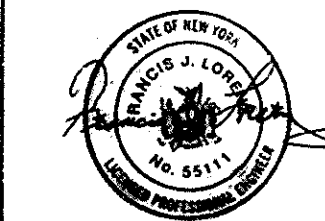

No.	Date	Revision	Approved
3/15/01		Drawings of Record	

**Engineering Department**  
**Design Divisions**

**The World Trade Center**  
**Electrical/HVAC**  
**Upgrade Program**

Title  
**LOW VOLTAGE DISTRIBUTION**  
**TWO WTC**  
**ELECTRICAL**  
**75TH FLOOR**  
**WEST SIDE**  
**BUS & RISER CABLE LAYOUT**  
**(SUBSTATION SS-75W)**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

CJ/CADU MW/CADU FJL  
Designed by Drawn by Checked by

Date 10/4/93 Scale 1/4" = 1'-0"

Contract Number Drawing Number

**WTC-804.041 E-18**